


GOVERNING SPECIFICATIONS:
THE MOST CURRENT EDITION OF NORTH CAROLINA DEPARTMENT
OF TRANSPORTATION "STANDARD SPECIFICATIONS" AND
"SUPPLEMENTAL SPECIFICATIONS AND RECURRING SPECIAL
PROVISIONS" HEREIN SHALL GOVERN, WHERE APPLICABLE.

CITY OF GREENVILLE, NORTH CAROLINA

PROJECT PLANS FOR THE CONSTRUCTION OF
RED TRAFFIC LIGHT MONITORING FACILITIES
AT THE INTERSECTION OF
CR 1707 / CHARLES BLVD AT CR 1703 / E. 14TH ST

VICINITY MAP

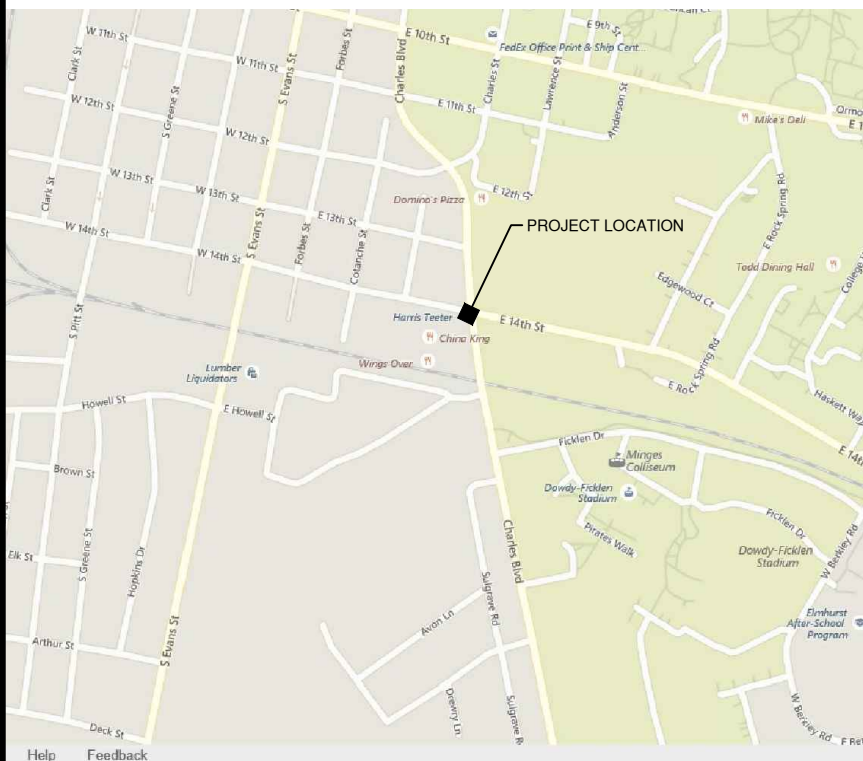

SHEET INDEX

<u>SHEET NO.</u>	<u>SITE ID</u>	<u>DESCRIPTION</u>
1	GE003, GE004	COVER SHEET
2		INTERSECTION PLAN
3		ATS STANDARD DETAILS
4		UNDERGROUND POWER SERVICE
5		REAR POLE DETAILS
6		DRILLED ANCHOR FOUNDATION
7		REINFORCED CONCRETE FOUNDATION
8-10		SPREAD FOOTING DETAILS



American
Traffic Solutions

RED LIGHT PHOTO ENFORCEMENT PROGRAM

1150 N. ALMA SCHOOL RD
MESA, AZ 85201 USA
TEL: (480)443-7000 FAX: (480)607-0901
WWW.ATSOL.COM

COVER SHEET

CR 1707 / CHARLES BLVD AT CR 1703 / E. 14TH ST
GREENVILLE, NC

[illegible]

1ST SUBMITTAL
DESIGNED BY: ATS
DATE: 04-16-17
APPROVED BY:
APPROVAL DATE:

JOB NUMBER
1487
SITE ID(S)
GE003, GE004

SHEET
NUMBER
1
OF **10** SHEETS

GENERAL & CONSTRUCTION NOTES

1.

SEPARATE RIGHT-OF-WAY PERMITS ARE REQUIRED FOR WORK WITHIN PUBLIC AGENCY RIGHT-OF-WAY. CONTRACTOR SHALL BE RESPONSIBLE FOR SUBMITTING APPLICATION PERMITS & FEE'S, AND COMPLY WITH ALL PUBLIC REQUIREMENTS.
2.

UTILITY LOCATIONS SHOWN ON PLANS ARE APPROXIMATE BASED ON AVAILABLE INFORMATION. CONTRACTOR SHALL BE RESPONSIBLE TO CONTACT DESIGNATED AGENCY TO LOCATE ALL UNDERGROUND UTILITIES 48 HOURS PRIOR TO COMMENCEMENT OF CONSTRUCTION.
3.

CONTRACTOR SHALL BE RESPONSIBLE TO APPLY AND OBTAIN AN APPROVED TRAFFIC CONTROL PLAN IN ACCORDANCE WITH MUTCD AND LOCAL STANDARDS AS REQUIRED.
4.

CONTRACTOR SHALL BE RESPONSIBLE TO RESTORE ALL DISTURBED AREAS TO ORIGINAL CONDITION TO AGENCY SATISFACTION AT NO ADDITIONAL COMPENSATION.
5.

CONTRACTOR SHALL TERMINATE ALL POWER CIRCUITS INTO ATS CABINET.
6.

INSTALL INLINE 30 AMP FUSE INSIDE HAND HOLE ON ATS CAMERA POLE.
7.

INSTALL FOUNDATION POLE AND GROUNDING WIRE FOR ATS EQUIPMENT. SEE LOCATIONS IN DRAWINGS AND POLE FOUNDATION DETAIL.
8.

INSTALL PULL/JUNCTION BOX OF THE REQUIRED SIZE AND TYPE PER LOCAL AGENCY STANDARDS.
9.

SCHEDULE 80 PVC CONDUIT TO BE BORED UNDER ROADWAY - 36" COVER MINIMUM. SEE SIZES AND LOCATION IN DRAWINGS.
10.

CONTRACTOR SHALL CALL NCDOT AND CITY TRAFFIC SIGNAL SUPERVISOR AT LEAST 72 HOURS IN ADVANCE TO COORDINATE THE POWER DROP INTO THE AGENCIES METER PEDESTAL.
11.

THE CONTRACTOR SHALL HAVE A LEVEL II IMSA CERTIFIED TECHNICIAN / ELECTRICIAN ON-SITE AT ALL TIMES DURING CONSTRUCTION. CONDUCTOR SPLICES AND TERMINATIONS SHALL BE MADE BY A QUALIFIED JOURNEYMAN ELECTRICIAN, WHO HAS SUCCESSFULLY COMPLETED A RECOGNIZED FOUR (4) YEAR APPRENTICESHIP PROGRAM UNDER THE DIRECT SUPERVISION OF A JOURNEYMAN ELECTRICIAN.
12.

TERMINATE RED & AMBER PHASE WIRES TO AGENCIES RED & AMBER PHASE CONDUCTORS IN THE NEAREST TRAFFIC CONTROL CABINET SEE CONDUCTOR RED & AMBER PHASE CONNECTION DETAIL. CONTRACTOR SHALL CONTACT NCDOT AND THE CITY TRAFFIC SIGNAL SUPERVISOR AND CITY POLICE DEPARTMENT FOR ON-SITE ASSISTANCE WITH RED & AMBER PHASE ISOLATION CONNECTION. ALLOW 24 HOURS ADVANCE NOTICE BEFORE CONNECTION.
13.

ALL WORK SHALL CONFORM TO ALL APPLICABLE ELECTRICAL CODES EXCEPT WHEN NCDOT OR CITY STANDARDS SUPERSEDE.
14.

CONTRACTOR SHALL TRIM EXISTING TREES TO IMPROVE LINE OF SIGHT NEEDED. CONTRACTOR SHALL NOTIFY CITY ARBORIST KEVIN HEIFFERON AT 252-378-5214, KHEIFFERSON@GREENVILLE.GOV, PRIOR TO TRIMMING.
15.

AT LOCATIONS WHERE EXISTING ENFORCEMENT EQUIPMENT MAY EXIST, CONTRACTOR SHALL COORDINATE WITH THE OWNER AND ATS PROJECT MANAGER FOR REMOVAL & SALVAGE.
16.


CONTRACTOR SHALL COORDINATE WITH NCDOT AND CITY TRAFFIC SIGNAL SUPERVISOR AND LAW ENFORCEMENT TO HAVE AN OFFICER PRESENT WHEN TRAFFIC SIGNAL POWER IS TURNED OFF FOR CONNECTION TO POWER PEDESTAL.
17.

CONNECT POLE TO SOLID BARE BOND GROUND & GROUNDING ROD (OR COIL 25' OF NO. 6 BARE COPPER) IN POLE FOUNDATION & TO SYSTEM GROUND BONDED BACK TO ATS CABINET(S).
18.


CONTRACTOR SHALL PLACE THE POLES / FOUNDATIONS IN A LOCATION TO MAINTAIN A 5' CLEAR SPACE FROM THE OVERHEAD POWER LINES. EARTH TO GROUND RESISTANCE NEEDS TO BE 25 OHMS OR ADDITIONAL GROUND RODS MAYBE NEEDED.
19.

CONTRACTOR TO LABEL EACH END OF ALL CABLE RUNS.
20.

CONTRACTOR TO INSTALL AND LEAVE IN PLACE NYLON DRAW STRING IN ALL CONDUIT RUNS.



DETAIL "A"
TYPICAL JUNCTION BOX DETAIL




- NOTES:
1.

CITY OF GREENVILLE TO LOCATE AND INSTALL.
2.

FLAT SHEET ALUMINUM HIGH INTENSITY 0.080.
3.

SIGN TO BE INSTALLED ON ALL APPROACHES.


A	B	C	D	E	F	G	H
450	10	15	75	200	56	125	40
750	13	20	125	335	94	219	50
900	15	25	150	400	112	250	60
1200	20	30	200	535	150	325	70



R10-18
RED LIGHT PHOTO ENFORCED


- SIGN COLORS:
- | | | |
|------------|---|--------------------------|
| LEGEND | - | BLACK |
| BACKGROUND | - | YELLOW (RETROREFLECTIVE) |

DETAIL "B"
PHOTO ENFORCEMENT SIGN DETAIL



DETAIL "C"
RED AND AMBER PHASE CONNECTION DETAIL

OPTO COUPLER



American
Traffic Solutions

RED LIGHT PHOTO ENFORCEMENT PROGRAM

1150 N. ALMA SCHOOL RD
MESA, AZ 85201 USA
TEL: (480)443-7000 FAX: (480)607-0901
WWW.ATSOL.COM

ATS STANDARD DETAILS

CR 1707 / CHARLES BLVD AT CR 1703 / E. 14TH ST


GREENVILLE, NC

NO.	BY	DATE	REVISION	NO.	BY	DATE	REVISION

1ST SUBMITTAL
DESIGNED BY: ATS
DATE: 04-16-17
APPROVED BY:
APPROVAL DATE:

JOB NUMBER
1487
SITE ID(S)
GE003, GE004

SHEET
NUMBER
3
OF 10 SHEETS

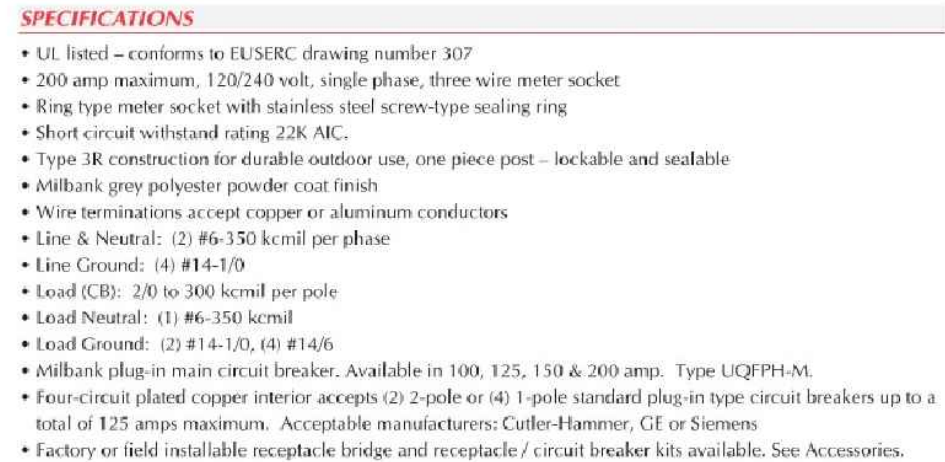

DETAIL "A"

METER PEDESTAL


USE MILBANK PEDESTAL (U5240-0-100S) OR APPROVED EQUAL

MANUFACTURE - SQUARE D OR EQUAL 22 KAIC						12/24 CIRCUIT, 125 AMP RATING 70A MAIN BREAKER						SINGLE PHASE, 120/240 V LOCATION - METER PEDESTAL					
LOAD	CONDUIT	WIRE	TRIP	1P/2P	VOLTS	DESCRIPTION	CKT	CKT	DESCRIPTION	VOLTS	1P/2P	TRIP	WIRE	CONDUIT	LOAD		
			30A	2P		SURGE ARRESTOR	1	2	RLC (ATS)	120	1P	30A	#10	2"	2135		
							3	4	SPACE								
						SPACE	5	6	RLC (ATS)	120	1P	30A	#10	2"	2135		
						SPACE	7	8	SPACE								
						SPACE	9	10	SPACE								
						SPACE	11	12	SPACE								
TOTAL LOAD: 2135 WATTS (PER RLC)																	
TOTAL AMPS: 30AMPS (PER RLC)																	


DETAIL "B"
ATS PANEL SCHEDULE

REAR CAMERA POLE


20' - 4.5" O.D. SCHEDULE 80
(6061 T6 ALUMINUM)



CAMERA & VIDEO CAMERA ENCLOSURE




ATS CABINET




- NOTES:
- 1. CABINET TO BE ROTATED PERPENDICULAR TO CURB.
 - 2. ORIENT (AIM) RADAR TOWARDS THE MIDDLE OF THE TOTAL NUMBER OF LANES ON THE FRONT SIDE OF THE FRONT POLE.
 - 3. LOCATE POLE PER PLAN.


PELCO CLAMPS




RADAR











FLASH STROBE




STROBE MOUNT





TYPICAL ALUMINUM POLE DETAIL DRILLED ANCHOR FOUNDATION DATA

POLE HEIGHT	ANCHOR SHAFT			HAND HOLE	BASE PLATE	HELICAL PLATE	PILOT DETAIL	
	A	B	C				G	H
20'	84"	6 5/8"	1/4"	18"	5 1/2"	14"	1"	5 15/16"




DETAIL 'C' POLE BASE DETAIL

GENERAL NOTES:




- DESIGN SHALL BE IN ACCORDANCE WITH 2009 (5TH) EDITION AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINARIES AND TRAFFIC SIGNALS AND INTERIMS.
- POLE MATERIAL SHALL BE SCHEDULE 80 ALUMINUM POLE FABRICATED USING 6061-T6 ALUMINUM ALLOY, THREADED ONE END NPT CUT TO LENGTH.
- ALL NUTS, BOLTS, WASHERS AND THREADED BARS/STUDS SHALL BE GALVANIZED PER F2329-05.
- UNLESS OTHERWISE NOTED ON THE PLANS, LOCATE HANDHOLE 180 DEGREES FROM CURB & GUTTER (FACING SIDEWALK).
- PROVIDE NUT AND WASHER WITH EACH BOLT.
- THREADS OF BOLTS SHALL BE COATED WITH PIPE JOINT COMPOUND PRIOR TO INSTALLATION OF UPPER NUTS WHEN ERECTING POLE. AFTER POLE IS PLUMBED AND IN PERMANENT ALIGNMENT. THE EXPOSED THREADS OF PAINTED BOLTS SHALL BE CLEANED AND AN ADDITIONAL COATING OF ZINC-RICH PAINT APPLIED TO SEAL THE BOLT THREAD-NUT JOINT.
- HELICAL PLATE SHALL BE HOT DIP GALVANIZED PER ASTM A123 GRADE 100 KSI.
- SQUARE BAR PILOT SHALL BE PER ASTM A576.

POLE DATA


POLE TUBE		POLE BASE			ANCHOR BOLT		
POLE O.D.	LENGTH	WALL THK	SQUARE	BOLT CIRCLE	THK	DIA	LENGTH
4 1/2"	20'	3/28"	14"	13 3/8"	5/8"	1"	5 1/8"



DETAIL 'D' POLE DETAIL




ALUMINUM POLE CONCRETE FOUNDATION DETAIL



TYPICAL ALUMINUM POLE DETAIL

GENERAL NOTES:


- DESIGN SHALL BE IN ACCORDANCE WITH 2009 (5TH) EDITION AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINARIES AND TRAFFIC SIGNALS AND INTERIMS.
- POLE MATERIAL SHALL BE SCHEDULE 80 ALUMINUM POLE FABRICATED USING 6061-T6 ALUMINUM ALLOY, THREADED ONE END NPT CUT TO LENGTH.
- ANCHOR BOLTS SHALL BE PER ASTM F1554 GRADE 55 KSI.
- REINFORCING STEEL SHALL BE ASTM A615 GRADE 60 KSI.
- ALL NUTS, BOLTS, WASHERS AND THREADED BARS/STUDS SHALL BE GALVANIZED PER F2329-05.
- UNLESS OTHERWISE NOTED ON THE PLANS, LOCATE HANDHOLE 180 DEGREES FROM CURB & GUTTER (FACING SIDEWALK).
- PROVIDE NUT AND WASHER WITH EACH ANCHOR BOLT.
- ANCHOR BOLT THREADS SHALL BE TAPED PRIOR TO POURING CONCRETE. THREADS OF ANCHOR BOLTS SHALL BE COATED WITH PIPE JOINT COMPOUND PRIOR TO INSTALLATION OF UPPER NUTS WHEN ERECTING POLE. AFTER POLE IS PLUMBED AND IN PERMANENT ALIGNMENT. THE EXPOSED THREADS OF PAINTED BOLTS SHALL BE CLEANED AND AN ADDITIONAL COATING OF ZINC-RICH PAINT APPLIED TO SEAL THE BOLT THREAD-NUT JOINT.
- ALL EXPOSED FOUNDATION SHALL BE FINISHED SMOOTH AND SHALL BE FLUSH WITH ADJACENT SIDEWALKS WHEN APPLICABLE.

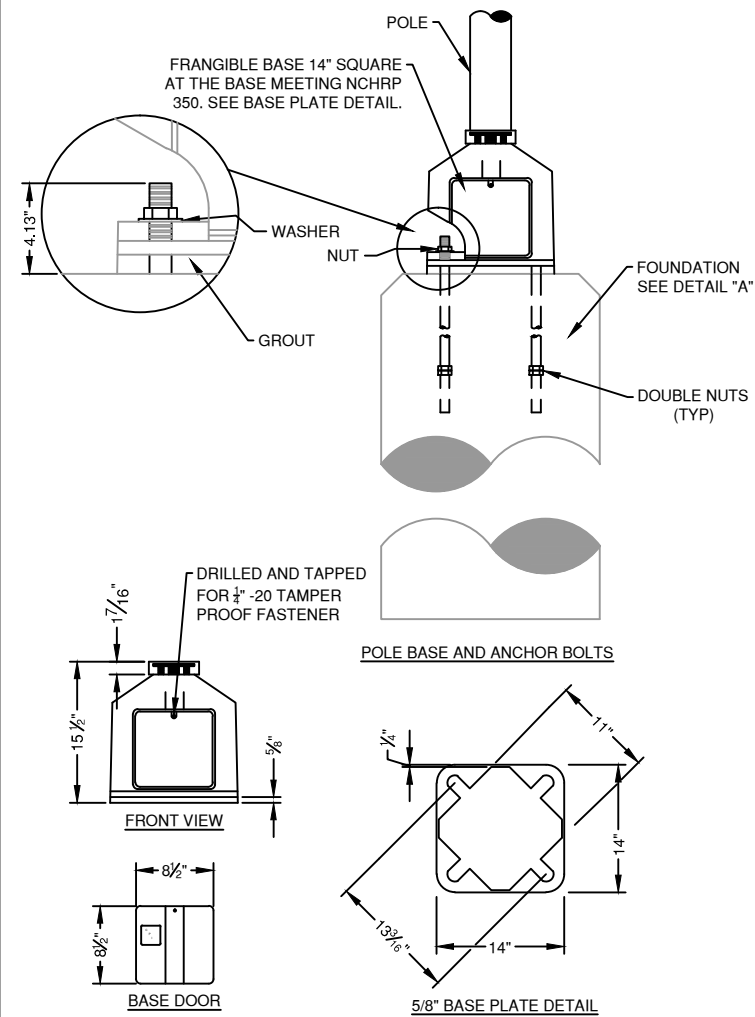

POLE BASE DETAIL

POLE DATA

POLE TUBE			POLE BASE			ANCHOR BOLT		FOUNDATION	
POLE O.D. (IN)	LENGTH (FT)	WALL THK (IN)	SQUARE (IN)	BOLT CIRCLE (IN)	THK (IN)	DIA (IN)	LENGTH (IN)	WIDTH (IN)	DEPTH (IN)
4.50	20.00	0.337	14.00	13.18	0.63	1.00	42.00	30.00	84.00



POLE DETAIL

GENERAL NOTES

1. SOIL SHOULD BE COMPACTED EVENLY AND FREE OF ORGANIC MATERIAL. EXERCISE CAUTION TO AVOID DAMAGE TO EXISTING UTILITIES.
2. PROTECT ADJACENT STRUCTURES AND FACILITIES. RESTORE ALL DAMAGED ITEMS (INCLUDING GRASSED AREAS) TO ORIGINAL CONDITION.
3. TOP OF FOUNDATION SHALL MATCH THE ADJACENT EXISTING SIDEWALK ELEVATION AND SHALL MATCH THE LONGITUDINAL GRADE & TRANSVERSE CROSS-SLOPE OF THE EXISTING SIDEWALK.
4. NEW SIDEWALKS SHALL MATCH EXISTING GRADE, CROSS-SLOPE, & ELEVATION OF EXISTING SIDEWALKS.
5. PROVIDE A BROOM FINISH ON TOP OF THE FOUNDATION AND NEW SIDEWALKS. ENSURE THAT SURFACE VARIATIONS DO NOT EXCEED 1/4" UNDER A 10 FOOT STRAIGHTEDGE OR 1/8" UNDER A 5 FOOT TRANSVERSE SECTION. FINISH EDGES WITH AN EDGING TOOL HAVING A 1/2 INCH RADIUS.
6. VERIFY UTILITIES (TYPE, LOCATION, & CONDITION) BEFORE STARTING CONSTRUCTION.

DESIGN CRITERIA

1. THE SPREAD FOUNDATIONS ARE DESIGNED TO SUPPORT ALUMINUM POLES WITH NEW GENERATION EQUIPMENT SHOWN.
2. DESIGN CONFORMS TO THE AASHTO *STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS* (CURRENT EDITION).
3. DESIGN WIND SPEED: 150 MPH
4. TO ALLOW FOR WIND FROM VARYING ANGLES, A TRANSVERSE COMPONENT OF 20% OF THE NORMAL WIND LOAD FORCES IS APPLIED SIMULTANEOUS WITH THE NORMAL WIND FORCES.
5. MAXIMUM ALLOWABLE DESIGN BEARING PRESSURE = 1000 PSF
6. FOUNDATIONS ARE DESIGNED TO LIMIT UPLIFT TO A MAXIMUM OF ONE CORNER AND TO LIMIT THE TENSION AREA TO LESS THAN 25% OF FOUNDATION AREA.

EQUIPMENT DATA

	WEIGHT (LBS)	EPA (SF) OR DIMENSION
300 WATT- SECOND STROBE:	34	1.00
WVD ANTENNA:	5	0.25
RED PHASE CAMERA (EACH):	40	0.60
CAMERA & AXIS LIVE VIDEO CAMERA ENCLOSURE:	100	2.50
ATS CABINET:	125	14.25" X 18.85" X 27"
		Cd=1.70

TRANSFORMER BASE: COMPONENT PRODUCTS, INC. CPI-BAS-1P

DESIGN LOADING

	CASE 1 TRANSVERSE UNIAXIAL	CASE 2 TRANSVERSE BIAXIAL	CASE 3 LONGITUDINAL UNIAXIAL	CASE 4 LONGITUDINAL BIAXIAL
POLE/EQUIPMENT AXIAL	480	480	480	480
POLE/EQUIPMENT MOMENT (MZ)	0	0	0	0
WIND SHEAR (VX)	1,190	1,190	0	240
WIND SHEAR (VZ)	0	240	1,190	1,190
WIND MOMENT (MX)	0	2,150	11,120	11,120
WIND MOMENT (MZ)	11,120	11,120	0	2,150

AXIAL AND SHEAR FORCES ARE IN LBS.
MOMENTS ARE IN FOOT*LBS

APPLICABILITY

THE DETAILS HEREIN ARE FOR SPREAD FOUNDATIONS FOR USE WITH THE AMERICAN TRAFFIC SOLUTIONS ALUMINUM REAR POLE WITH NEW GENERATION EQUIPMENT AS SHOWN.

THESE FOUNDATIONS ARE NOT APPLICABLE FOR USE WITH OTHER TYPES OF POLES AND/OR EQUIPMENT.

MATERIAL NOTES

1. CONCRETE: CLASS C
(28-DAY MINIMUM COMPRESSIVE STRENGTH = 3,600 PSI)
2. REINFORCING STEEL: ASTM A615, GRADE 60
3. ANCHOR RODS:

A. RODS: ASTM F1554, GRADE 55


B. NUTS: ASTM A563, GRADE A HEAVY HEX

C. GALVANIZE RODS & NUTS IN ACCORDANCE WITH ASTM F2329.
4. CONCRETE COVER:

3" TOP


3" SIDES

3" BOTTOM



LOADING DIAGRAM

THESE SPREAD FOUNDATIONS SHALL NOT BE USED OVER:
1) GAS, PROPANE, LNG, OR OTHER FLAMMABLE UTILITIES;
2) CONCRETE ENCASED DUCTBANK;
3) CONDUITS OTHER THAN PVC CONDUITS
OR
4) MULTIPLE UTILITIES
WITHOUT THE PRIOR REVIEW AND SIGNED & SEALED WRITTEN APPROVAL OF A REGISTERED PROFESSIONAL ENGINEER.



ALUMINUM REAR POLE
WITH NEW GENERATION EQUIPMENT

SPREAD FOOTING NOTES

CR 1707 / CHARLES BLVD AT CR 1703 / E. 14TH ST
GREENVILLE, NC

NO.	BY	DATE	REVISION	NO.	BY	DATE	REVISION

1ST SUBMITTAL
DESIGNED BY: ATS
DATE: 04-16-17
APPROVED BY:
APPROVAL DATE:

JOB NUMBER
1487
SITE ID(S)
GE003, GE004

SHEET
NUMBER
8
OF 10 SHEETS





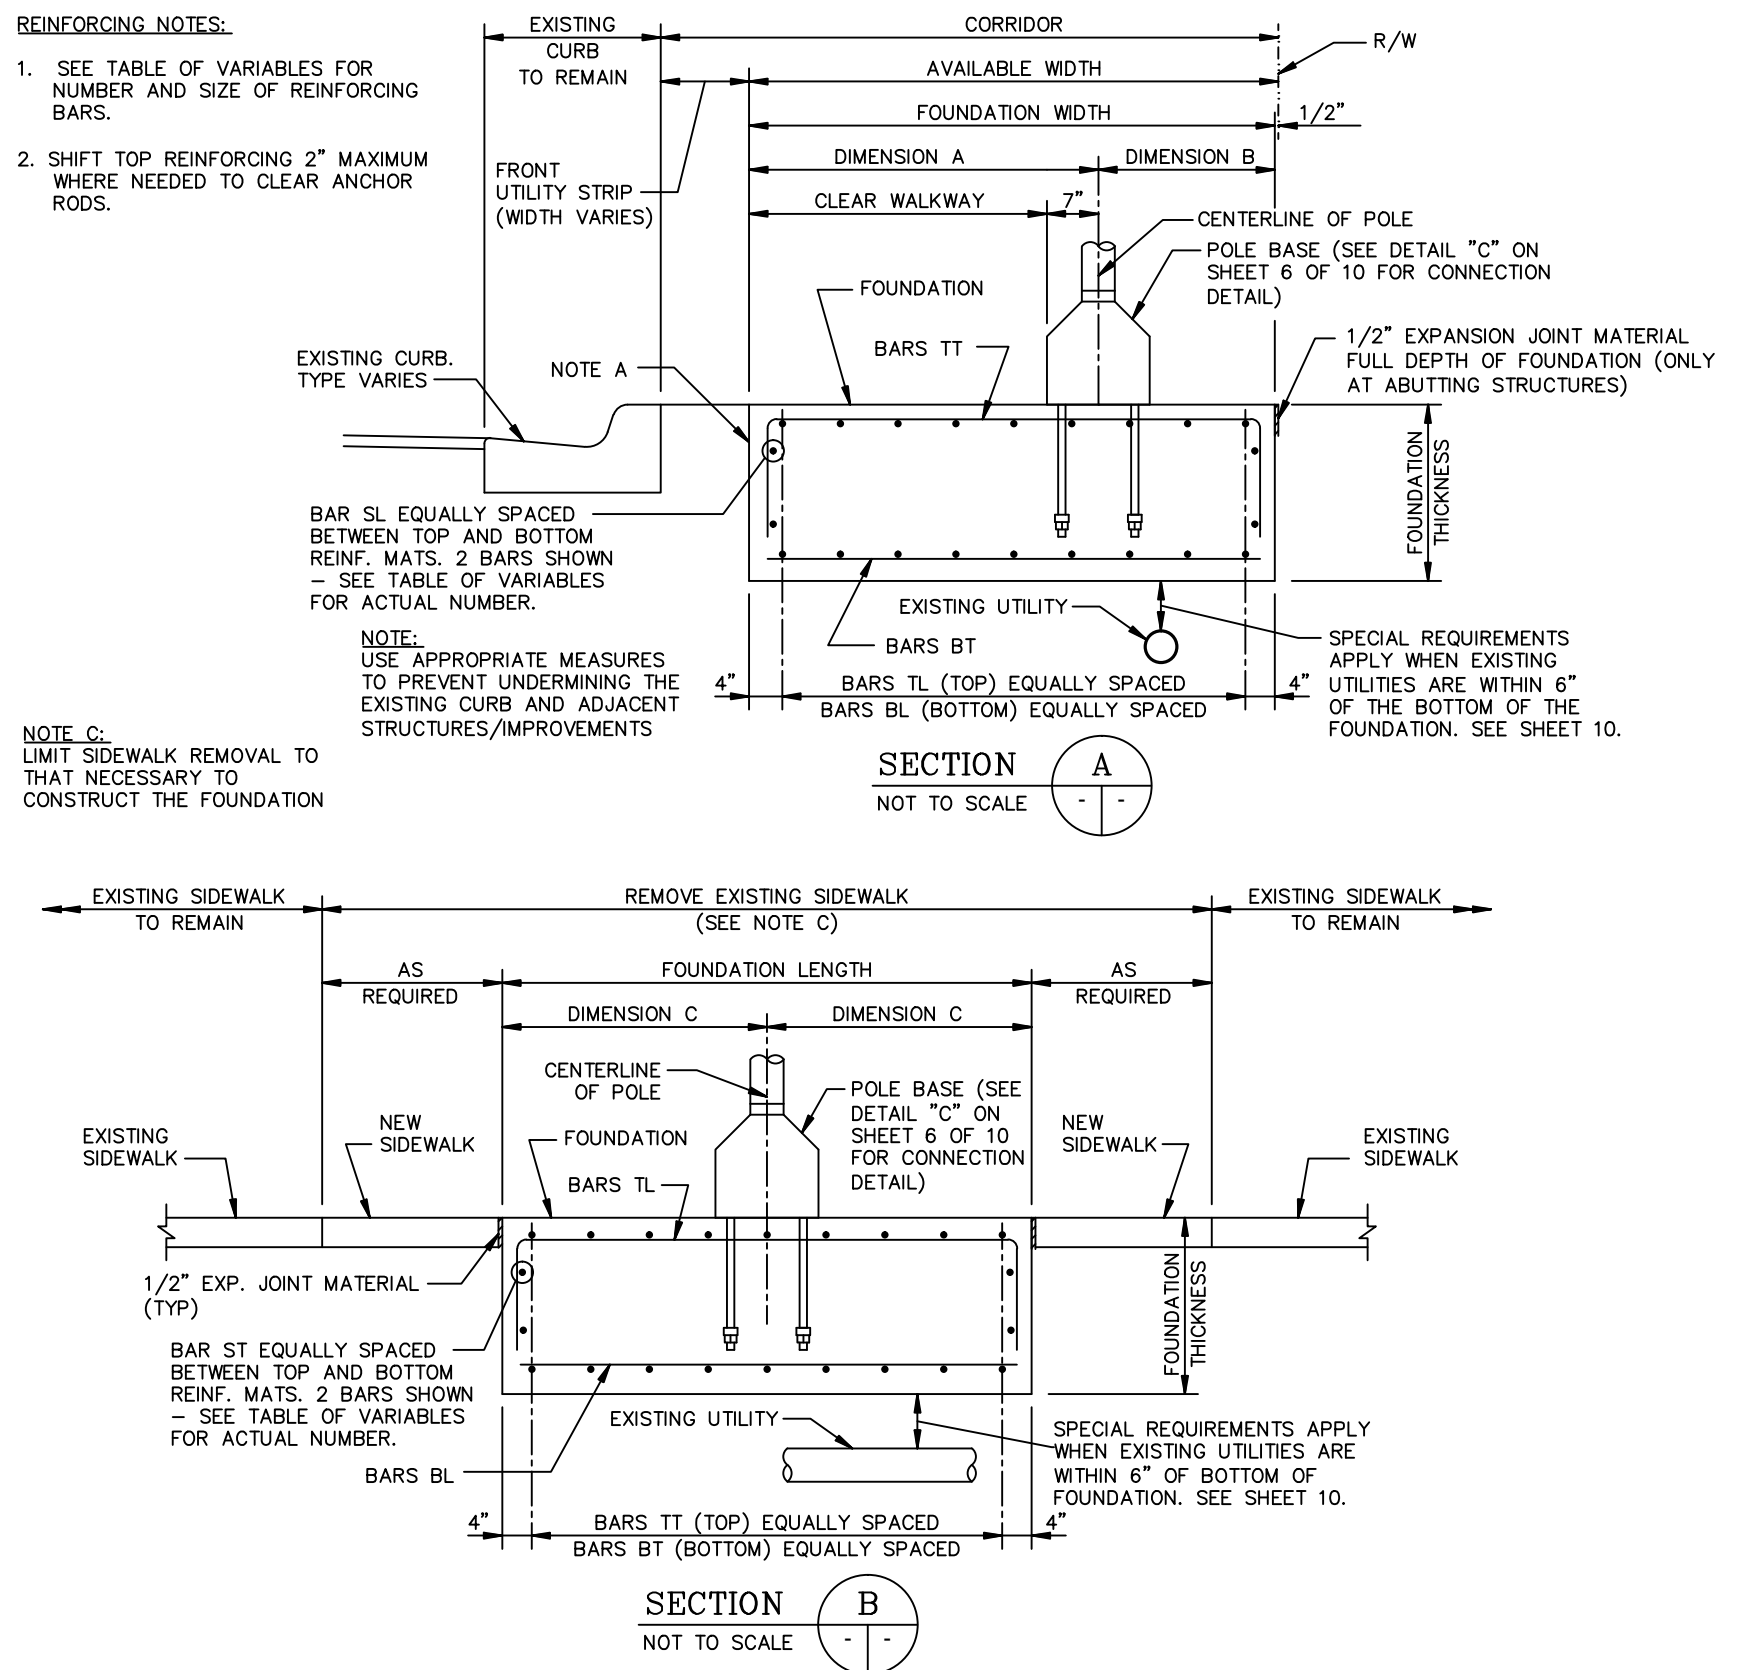


TABLE OF VARIABLES						
	AVAILABLE WIDTH					
	5'-0"	5'-6"	6'-0"	6'-6"	7'-0"	7'-6"
FOUNDATION WIDTH ①	4'-11 ½"	5'-5 ½"	5'-11 ½"	6'-5 ½"	6'-11 ½"	7'-5 ½"
FOUNDATION LENGTH	8'-6"	8'-6"	9'-0"	8'-6"	7'-6"	7'-0"
FOUNDATION THICKNESS	34"	27"	20"	18"	18"	18"
REINFORCING BARS TT	13 - #4	10 - #4	11 - #4	11 - #4	9 - #4	9 - #4
REINFORCING BARS TL	8 - #4	7 - #4	7 - #4	8 - #4	9 - #4	10 - #4
REINFORCING BARS ST	3 - #5	2 - #5	1 - #5	1 - #5	1 - #5	1 - #5
REINFORCING BARS SL	3 - #5	2 - #5	1 - #5	1 - #5	1 - #5	1 - #5
REINFORCING BARS BT	13 - #5	10 - #5	11 - #5	11 - #5	9 - #5	9 - #5
REINFORCING BARS BL	8 - #5	7 - #5	7 - #5	8 - #5	9 - #5	10 - #5
CLEAR WALKWAY ①	2'-8 ½"	2'-8 ½"	3'-0 ½"	3'-6 ½"	3'-6 ½"	3'-6 ½"
DIMENSION A ①	3'-3 ½"	3'-3 ½"	3'-7 ½"	4'-1 ½"	4'-1 ½"	4'-1 ½"
DIMENSION B	1'-8"	2'-2"	2'-4"	2'-4"	2'-10"	3'-4"
DIMENSION C	4'-3"	4'-3"	4'-6"	4'-3"	3'-9"	3'-6"
DIMENSION R	4'-5"	4'-11"	5'-5"	5'-11"	6'-5"	6'-11"
DIMENSION S	8'-0"	8'-0"	8'-6"	8'-0"	7'-0"	6'-6"
DIMENSION T	2'-1"	1'-6"	0'-11"	0'-9"	0'-9"	0'-9"


① DECREASE DIMENSION BY ½" IF CURB ABUTS FRONT FACE OF SIDEWALK

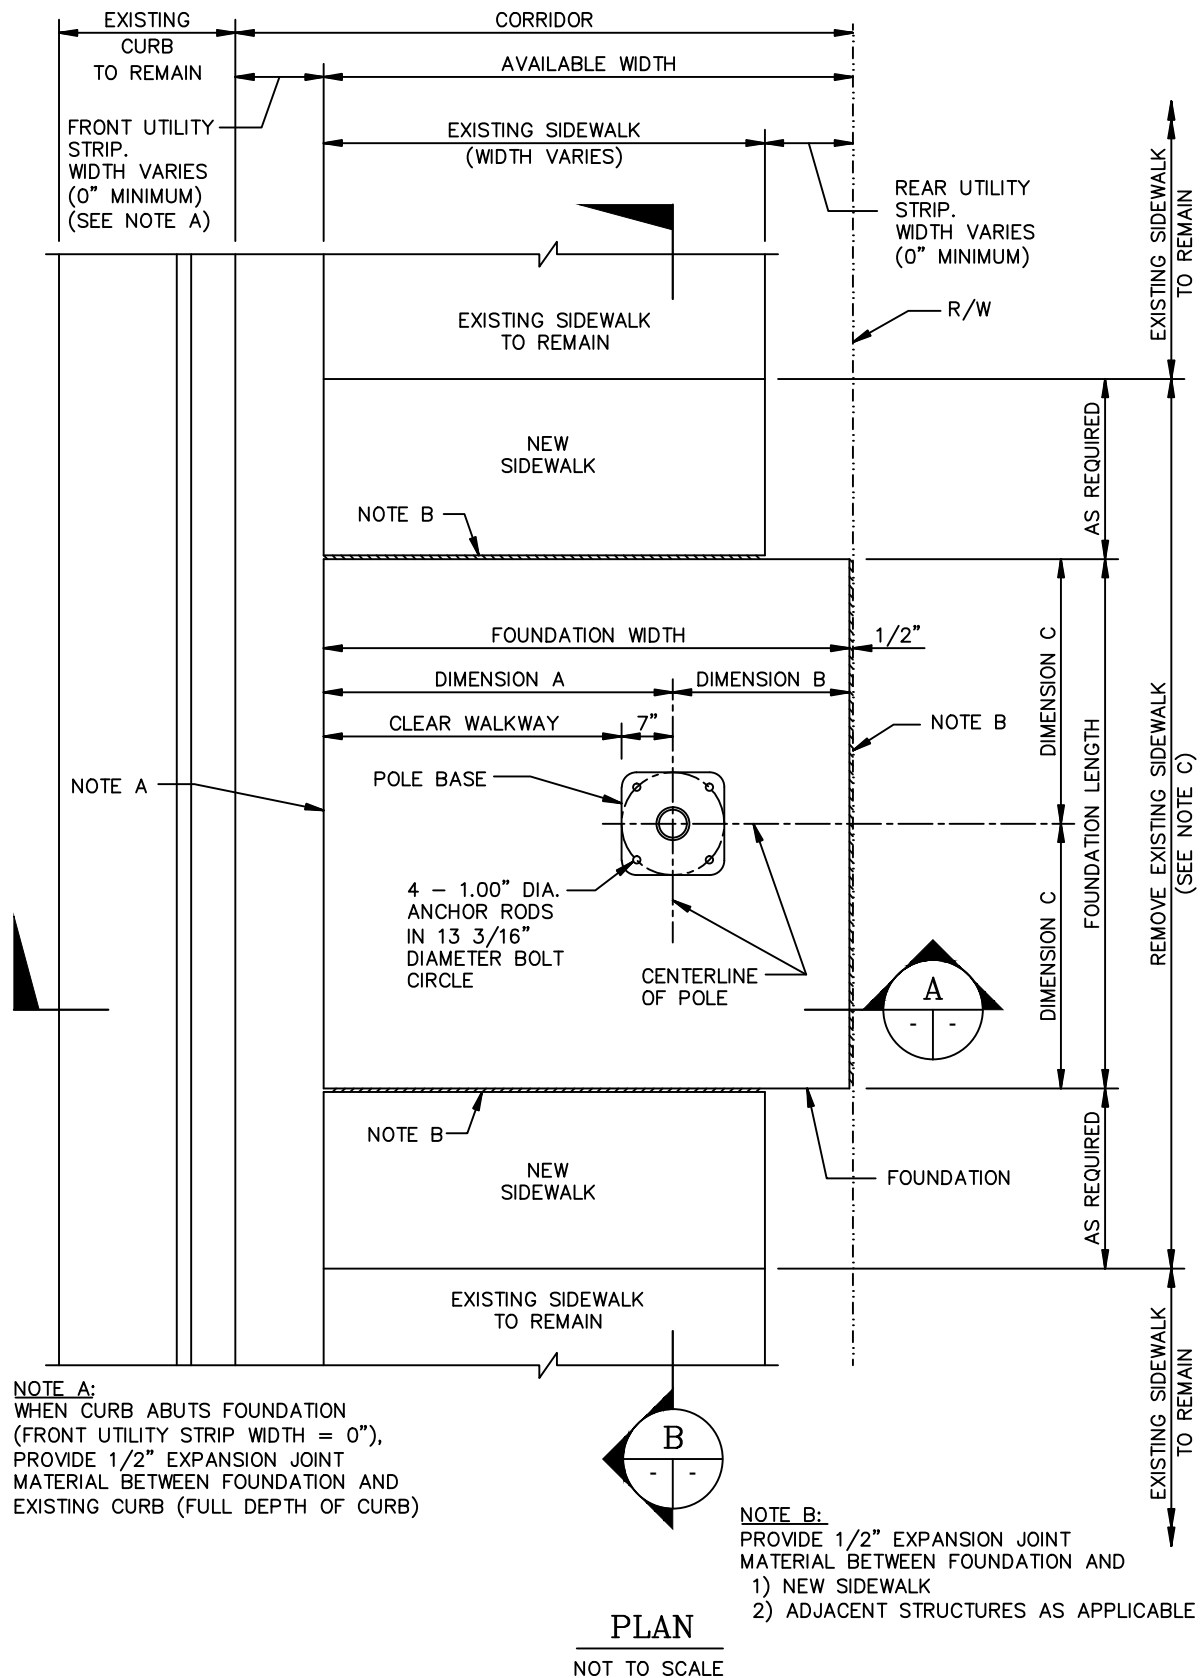


REINFORCING BARS



ANCHOR RODS
NOT TO SCALE

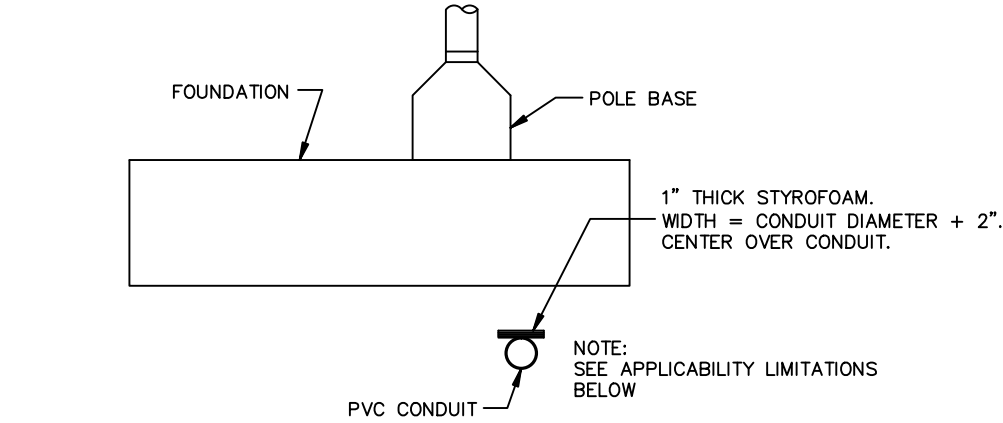

TRANSVERSE SECTION



LONGITUDINAL SECTION

SPECIAL REQUIREMENTS AT UTILITIES

NOT TO SCALE

APPLICABILITY LIMITATIONS:

1. DETAILS SHOWN ARE APPLICABLE ONLY FOR A SINGLE PVC CONDUIT WITH A MINIMUM OF 1" CLEAR DISTANCE FROM THE TOP OF THE CONDUIT TO THE UNDERSIDE OF THE FOUNDATION.
2. NO MODIFICATIONS ARE NEEDED FOR A SINGLE PVC CONDUIT WITH MORE THAN 6" CLEAR DISTANCE FROM THE TOP OF THE CONDUIT TO THE UNDERSIDE OF THE FOUNDATION.
3. ALL OTHER CONDITIONS (DIFFERENT TYPE OF CONDUIT, MULTIPLE CONDUITS, ETC.) REQUIRE THE REVIEW AND APPROVAL OF A PROFESSIONAL ENGINEER.